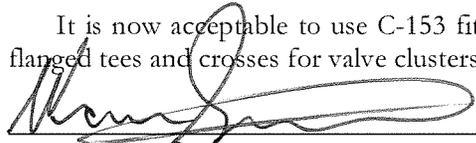

INTEROFFICE MEMORANDUM

TO: ENGINEERING DIVISION
FROM: JANINE RODRIGUEZ ON BEHALF OF WARREN STEWART
SUBJECT: CHANGE IN SUPPLEMENTAL SPECIFICATIONS
DATE: 6/2/11

Effective immediately, the text in Section 401 (Water Pipe and Fittings), Part 2 (Materials), 2.3 (Ductile Iron Pipe and Fittings) in the Meridian Supplemental Specifications and Drawings to the Idaho Standards for Public Works Construction 2008 Edition, which states, "Tees and Crosses shall be flange type unless no other fitting or valve is installed back-to-back, in which case mechanical joint type shall be used" is no longer valid and is to be removed from the specification.

It is now acceptable to use C-153 fittings. However, we will continue to use C-110 fittings for flanged tees and crosses for valve clusters, large services and hydrant runs.



Signature

6/10/11
Date